

65000

i p i l i i i m i

0

273



i



2000

5

OPGW

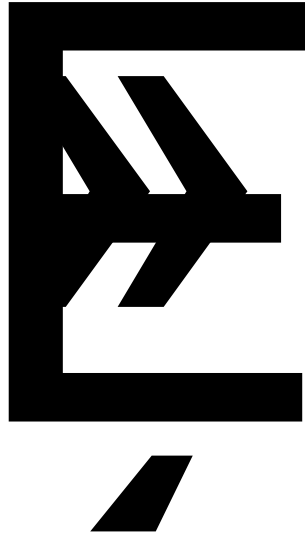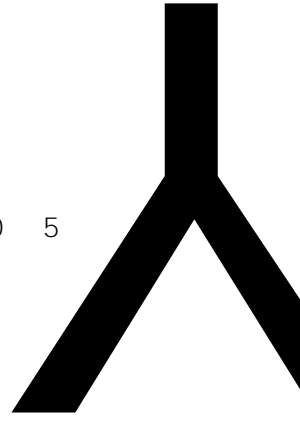



3.1

4.1

4.2

77

82

35

PCT

5

4



2

4.3

21

2


1	IEEE 1138-2021	IEEE Standard for Testing and Performance for Optical Ground Wire (OPGW) for Use on Electric Utility Power Lines OPGW	
2	IEEE 1595-2022	IEEE Standard for Testing and Performance for Optical Phase Conductor (OPPC) for Use on Electrical Utility Power Lines ----- OPPC	
3	IEC	1-404	-

	60794-1-404-2022-0	-	H4			
	2					
	IEC	1-220		-	-	-
4	60794-1-220-2022		F20			
5	IEEE 1591.1-2023	IEEE Standard for Testing and Performance of Hardware for Optical Ground Wire (OPGW)				
6	Q/GDW 761-2012		OPGW			
7	CSN EN 60794-4-10	4-10				
8	GBT 17937-2024					
9	DL/T 832-2016					
10	DL/T 1613-2016					
11	DL/T 1601-2016					
12	DL/T 1733-2017					
13	YB/T 4682-2018					
14	T/CEC 186-2018					

4.5

“ “ - ”
“ ”

3



"

"

"

"

AAA

2024

"

AA

"

6.1

I SO 14001

I SO 45001

6.2

72L, 2.5tCO2e

8%

1 HF3

4

10362.96kWh

6.4

" "

CSR

CSR

CSR

"

£

2

∇

f

Σ

σ

φ



7.1

"

"

8.1

100%

8.2

8.3



" "

1

400

800

2000

" "

2

3

" "

4

"

"

8.4


8.5

8.6



WAG

WAG




				65dB			
				55dB			100%
				100%			

9.2

(1)



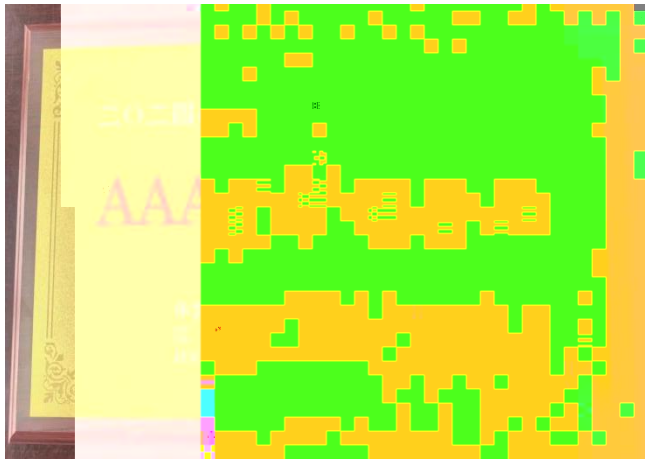

2024 4 ,

330kV

CPGW

2024 " 9.6"

" "

